




Closed
to create two
separate air circuits

Installed

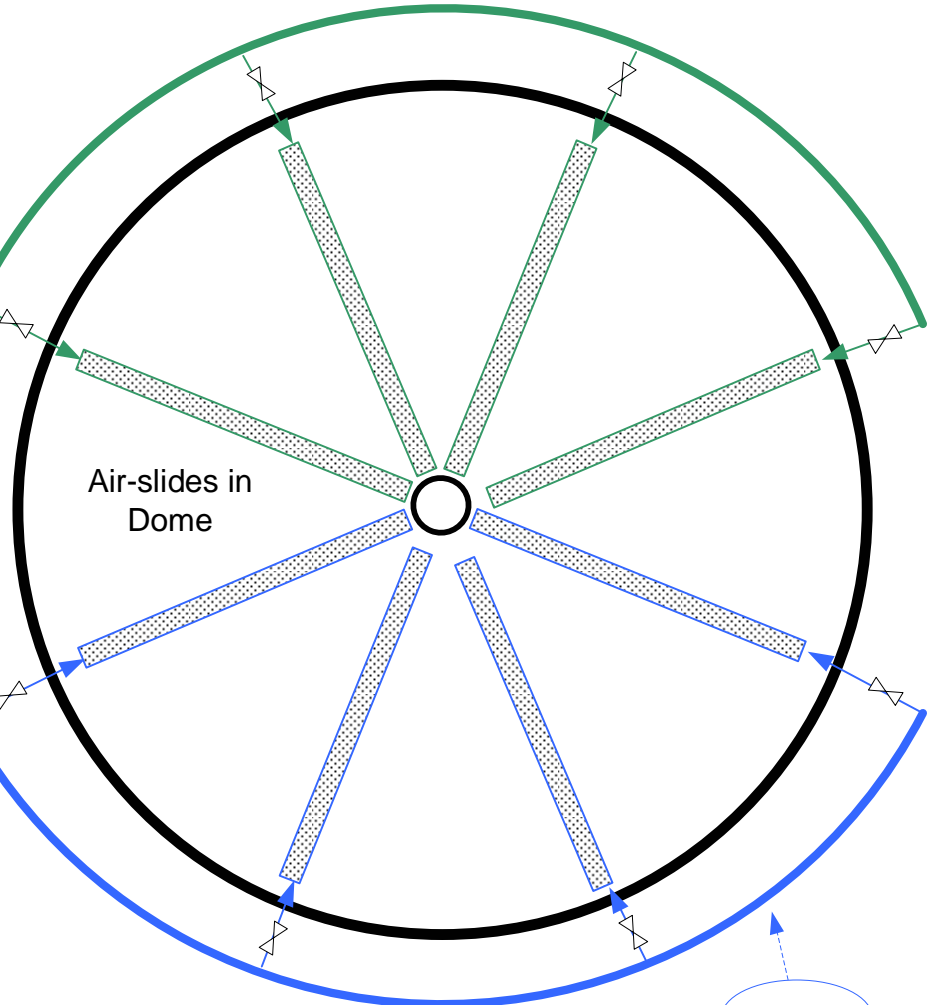


TEI Fluidizer Field Test Unit



Air Circuit #2

Before



Blower

Single Air
Circuit

